
# PERSONAL VOLTAGE DETECTOR VW-250

## **Operating & Instruction Manual**





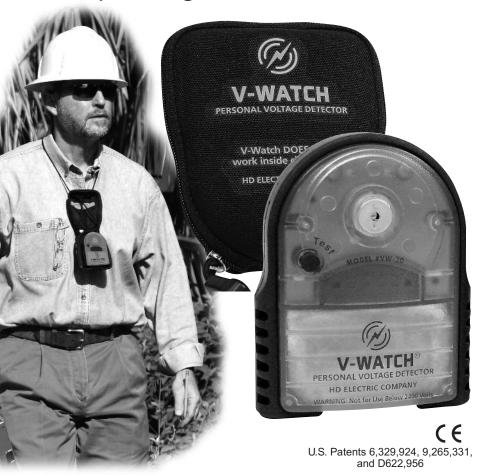

## **Operating & Instruction Manual**

GENERAL DESCRIPTION
POINTS TO UNDERSTAND BEFORE PROCEEDING
SAFETY
WARNINGS
HOW IT WORKS
HOW TO WEAR IT
WHEN AND HOW TO USE IT
A WORD ABOUT ELECTRIC FIELDS
LIMITATIONS FOR USE
INSTRUCTIONS FOR USE
TECHNICAL SPECIFICATIONS
WARNING DISTANCE11
TERMS AND CONDITIONS OF SALE



For the latest information on V-Watch Personal Voltage Detectors including product updates and technical information, visit our website at www.HDElectricCompany.com

#### GENERAL DESCRIPTION

The V-Watch Personal Voltage Detector detects the strong electric fields surrounding high voltage conductors and power distribution equipment. It is a small pocket size device worn on the outside of the clothing or other protective gear by users operating near power lines or high voltage equipment. It provides an extra level of safety for personnel trained in the use and application while working on or near high voltage systems.



# The V-Watch Personal Voltage Detector detects electric fields. Make sure you understand these points before proceeding:

- Electric fields surround every energized AC conductor.
- The closer you are to a conductor, the stronger the field will be.
- Higher voltage means a stronger electric field and a greater warning distance.
   Lower voltage means a reduced warning distance.
- Electric fields are NOT blocked by plastics, dry wood or clothing.
- Electric fields ARE blocked by ANY conductor such as a metal cabinet or door, wet wood, metal fences, green trees, a growing shrub or hedge and tall wet grass.
- The detector will not find cables buried under the ground. The ground is a conductor and will block electric fields.
- Insulation on a wire does not block the electric field and does not affect warning distances.
- Underground primary cables are both insulated AND shielded.
   The shield is a conductor, is grounded, and will block the electric field.
- Molded cable terminators such as elbows are, like the cables they are installed on, both insulated and shielded and will block electric fields.
- Your body will block electric fields. Wear the detector front and center and do not walk backwards.
- Do not use the detector while holding it in your hand. Wrapping your fingers around the device will block electric fields, preventing it from working properly.

#### SAFETY

- Always use proper high voltage procedures, including personal protective equipment, when working near or around high voltage equipment or conductors.
- Do not rely on the detector as your sole source of high voltage detection. Risk of electrocution is inherent in or around high voltage.
- · Never contact high voltage with the detector.
- · Always use proper high voltage procedures for testing and grounding.
- Because the human body is a good electrical conductor, electric fields are distorted or blocked by the body. Thus, positioning of the detector on the body and its location relative to the voltage source can have a large effect on its sensitivity to electric fields.
- Grounded equipment can appear to be live in close proximity to energized conductors.
- The V-Watch Personal Voltage Detector is not sensing electric fields when it is inside its closed carrying case.

#### **WARNINGS**



All V-Watch Personal Voltage Detector carrying cases are electrically shielded, therefore, the device does not work when inside its closed carrying case.



### NOT FOR USE BELOW 2400 VOLTS AC.

#### OPERATIONAL IMPAIRMENT

If the detector is used in a manner not described in this instruction manual, the protection And effective operation of this equipment may be impaired.

The detector will not detect DC voltage or stored charge such as in charged capacitors or underground cable. When the detector is inside its closed case, it will not detect or warn of nearby high voltage. Always use proper high voltage procedures, including personal protective equipment, when working near or around high voltage equipment or conductors. Never contact high voltage. Always use proper high voltage procedures for testing and grounding. Do not rely on the V-Watch Personal Voltage Detector as your sole source of high voltage detection. Risk of electrocution is inherent in or around high voltage.

#### **HOW IT WORKS**

The V-Watch Personal Voltage Detector works by sensing the presence of the electric field surrounding anything that potentially conducts high voltage electricity and sounds an alarm. It measures the strength of the electric field; a higher voltage or stronger field will cause the detector to alarm from a greater distance.

It emits a series of loud beeps and flashing lights when an electric field is first detected. The beeps and flashing lights increase in frequency as the user approaches the source of the high voltage electric field. A steady tone indicates very close proximity to high voltage and the need for extreme caution. This variable beeping rate helps the user to determine if they are approaching the high voltage source or moving away from it to safety.

The detector has a self-test button to verify battery power and proper functioning of the device. It will also sound an alarm to warn the user of a low battery. Whenever the detector is being used, it is always on, checking for the presence of high voltage electric fields. A standard 9-volt alkaline battery powers the unit for about one year.

For more information, refer to the A Word About Electric Fields section on page 6.

#### HOW TO WEAR IT

The V-Watch Personal Voltage Detector should always be worn mid-torso on the front of the body and face in the direction of movement. Because it is sensitive to electric fields in front of the user, and to a lesser extent on either side, proper positioning is important.

# V-Watch Personal Voltage Detectors can be worn in two different ways:

- When using the detector with the C-10 Case Lanyard, fully unzip the carrying case so that the case opens downward and the detector is now facing forward. Extend the lanyard from the top of the case and hang it around your neck. Adjust the lanyard so the detector in the case is located at mid-torso and facing forward.
- The second option is using the detector with the metal mounting clip and securing it on clothing or other devices such as fall protection gear so it is located at mid-torso and facing forward.



The V-Watch Personal Voltage Detector can be used anytime, anyplace and for any reason. The decision of when to use it is made by the user and by your company's safety and work practices.

When used properly, the detector can provide an additional warning to users exposed or working around energized high voltage electricity and equipment. Awareness of the presence of a high voltage electric field allows the user to take additional precautions against accidental contact with energized equipment. The variable frequency beeping gives the user an indication of the source and direction of the high voltage.

The detector provides an early warning of the proximity of potentially hazardous high voltage electricity and equipment. It will start to beep slowly as an electric field is first detected and will then beep faster, increasing to a steady tone if the user continues to approach the source of the high voltage electric field. A steady tone indicates the need for extreme caution, as the source of the high voltage electric field is close.







#### A WORD ABOUT ELECTRIC FIELDS


Electric fields surround every energized conductor. The V-Watch Personal Voltage Detector measures the strength of these electric fields to warn the user when fields are strong enough to indicate the presence of nearby high voltage conductors.

A downed power line is a typical hazardous situation where the detector can provide a warning. This power line lying on the ground sets up a high voltage field surrounding the conductor that the detector

will sense and warn the user.


The detector is designed to be worn on the body and it measures the electrical fields typically found in close proximity to the body. Because the human body is a good electrical conductor, electric fields are distorted or even blocked by the body. Thus, positioning of the detector on the body and its location relative to the voltage source can have a large effect on its sensitivity to electric fields.

When properly worn on the front of the body, as shown, and with the user facing a waist height energized conductor, such as a terminal on a pad mount transformer or switch, the detector will start to alarm about 10 feet from a 7kV conductor. If the user were to approach this energized terminal by backing up to it, the warning distance may be reduced to 3 feet or less.



If the user bends over from the waist to reach towards an energized high voltage terminal, the warning distance may also be significantly reduced. In both cases, the high conductivity of the body acts as a shield to conduct the electric field around the detector.

The V-Watch Personal Voltage
Detector measures only the
strength of the electric field.
It cannot directly measure distance
to the source of the electric field
such as an energized conductor. The
higher the voltage, the stronger the




field and the greater the alarm distance. The reverse is also true; the detector may alarm due to the very close proximity of low voltage when the user walks past a typical factory machine such as a running drill press, an office computer terminal or a desk lamp. It may even alarm if it is placed up against a typical 120 volt wall outlet.

Electrically conductive objects located underneath power lines can appear to be live. A metal fence or a growing hedge can cause a distortion of the electric field under these lines and result in high electric field strength near the ground. The V-Watch Personal Voltage Detector will provide an early warning of high electric fields, but not all fields are directly caused by nearby energized objects. To prevent the detector from issuing too many false alarms, it should not

be used or worn in typical office or factory environments where all the equipment is low voltage and there is no danger of contacting energized high voltage conductors.


As an additional protection against false alarms from transient voltages, the detector has a built-in time delay and may take up to one second to emit an alarm warning of high voltage. For this reason, a user running towards an energized high voltage source may find the warning distance reduced.

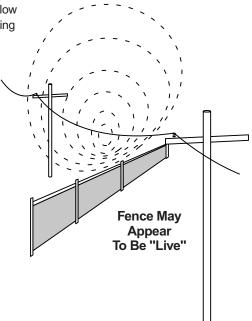


#### LIMITATIONS FOR USE



WARNING: Conductors lying on the ground or very close to it will result in reduced warning distances.



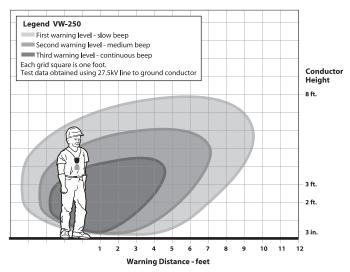

Conductors of different phases in close proximity will also reduce warning distances due to field cancellation effects.

Wearing the V-Watch Personal Voltage Detector in environments such as substations or under transmission lines may result in the detector alarming continuously.

Be aware of unique conditions that may be present around three phase delta systems. Unlike grounded Y systems, a single phase of a delta system can become grounded without causing an outage and the delta system can continue to operate with this grounded phase. If this phase is grounded as a result of a downed conductor or other storm damage, it may be grounded only temporarily and could become reenergized if moved or disturbed. The V-Watch Personal Voltage Detector will not detect any grounded conductor, whether it is a grounded delta phase conductor, a guy wire or a pole ground.



WARNING: Treat all conductors as live unless or until there is a visible break from a live source and a ground is in place.

#### INSTRUCTIONS FOR USE



## NOT FOR USE BELOW 2400 VOLTS AC.

Before using, read the instruction manual, review product labeling and both sides of the instruction card located in the case. Do not proceed if the instruction card is missing. Make certain that the detector is equipped with a 9-volt battery. Press the Test button on the front of the detector before and after each use. The test circuitry generates an internal voltage which the detector then detects by turning on the lights and sounding the beeper. DO NOT USE the detector if the Test button fails to activate the lights and beeper. Remove from service and contact the factory to arrange for repair.



CAUTION – Press and hold the Test button before and periodically during as well as after each use to ensure proper operation.

The detector should always be worn facing any potential high voltage electricity. Wear the detector in the center of the front of your body as shown in the illustration and always wear in the direction of movement or work. Do not walk backwards or sideways when wearing

the detector as it will not detect high voltage behind you or as effectively to the sides. Wear on the outside of all clothing. Keep it away from all other large metal objects such as belt buckles, tool belts or electronic items such as radios, pagers, cell phones or any other electrical devices which may interfere with the detector.

The detector will emit a series of beeps and flashing lights when it detects high voltage. It will beep and flash faster as it gets closer to high voltage. Very rapid beeping and flashing or a steady tone and lights indicates close proximity to high voltage and requires extreme caution. For more details, refer to Warning Distances on page 11.

Instruction Card - Front & Back





When the V-Watch Personal Voltage Detector is in use with a good working battery, it is always on, always ready to warn of potentially hazardous high voltage. The battery life is approximately one year on the job or two years in storage. When the job requiring the protection of the detector for the user is completed, the detector should be closed inside its protective carrying case. The carrying case is electrically shielded and turns the V-Watch detector off when it is stored inside.



CAUTION: The V-Watch Personal Voltage Detector is not sensing electric fields when it is inside its closed carrying case.

The V-Watch Personal Voltage Detector will indicate if it has a low battery. When the battery gets low the beeper and lights are activated. The beeper will give a constant tone and the lights remain lit indicating the battery needs to be replaced (the same indication as pressing the Test button). The low battery signal will continue until the battery is completely discharged or removed. When this happens, the detector is no longer operational until the 9-volt battery is replaced.

To replace the battery, completely remove the detector from the case and access the battery through the door on the back. Disconnect and dispose of the old battery, replacing it with a fresh, new 9-volt alkaline battery. Be sure to connect the proper battery polarity and carefully manage the wire leads to avoid pinching between the battery door and the body while replacing the cover. Press and hold the Test button to confirm proper operation. If after changing the battery the test button fails to confirm proper operation, DO NOT USE. Remove it from service and contact the factory to arrange for repair.

#### **CLEANING**

To clean, wipe with a damp cloth with water. Do not use harsh chemicals or solvents.

#### **TECHNICAL SPECIFICATIONS**

**SENSITIVITY**: Factory set at 50/60 Hz sensing threshold (first beep). The detector will only detect AC voltage. Do not use below 2400 Volts.

TYPICAL WARNING DISTANCE: 9 feet (2.7m) from a 27kV AC conductor.

For more details, refer to Warning Distances on page 11.

**OPERATING FREQUENCY: 50Hz/60Hz** 

BATTERY: 9V alkaline 1604A, IEC 6LR61. Life 2 years in storage, one year typical usage.

BEEPER SOUND PRESSURE LEVEL: 100 db.

WEIGHT WITH BATTERY: 5.2 oz (147q)

**DIMENSIONS**: 3.5" (8.89cm) x 2.8" (7.32cm) x 1.2" (3.18cm)

VOLTAGE RANGE: 2400VAC and above.

ENCLOSURE MATERIAL: ABS UL 94-HB

PRINTED CIRCUIT BOARDS: FR-4 UL94V-0

#### **ENVIRONMENTAL CONDITIONS**

**CONDITIONS**: Indoor and outdoor use **ALTITUDE**: Up to 6,566 ft. (2000M)

OPERATING TEMPERATURE: -20°F to +120°F (-29°C to +49°C)

HUMIDITY: 95% to 49°C (non-condensing)
OVERVOLTAGE CATEGORY: II Non-contact


**POLLUTION DEGREE: PD4** 

#### **REPAIRS**

If any damage is found please contact us at 800-435-0786 to arrange for service.

MANUFACTURING LOCATION HD Electric • Southaven, MS, 38672 USA

#### WARNING DISTANCES

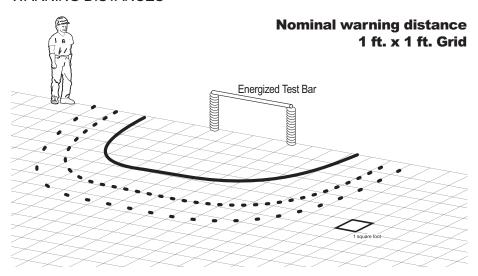

#### **Test Details**

All of the warning distances are shown on a 1 foot grid and all distances are to scale.

The energized bar is 4 feet long and 30 inches above the ground on insulators. It is energized from behind and the indicated voltage is line to ground.

Voltage. 27.5 KV Lille-Ground				
	Slow Beep	Fast Beep	Continuous	
Location				
Side of Bar	9 ft.	7 ft.	5 ft.	
End of Bar	6 ft.	5 ft.	3.5 ft.	

Voltage: 27.5 kV Line-Ground

For this test, the V-Watch Personal Voltage Detector VW-250 was worn on the shirt front as pictured. Warning distances will be reduced slightly if it is worn on the belt and will be reduced substantially if an arm is extended toward the energized source or if the user approaches the energized source backwards.

#### TERMS AND CONDITIONS OF SALE

HD Electric Company is herein referred to either as "HDE" or "Seller" and the customer or person or entity purchasing goods or services (hereinafter collectively referred to as "Goods") is referred to as "the "Buyer". These Terms and Conditions, any price list or schedule, guidation, acknowledgment or invoice from HDE relevant to the sale of the Goods and all documents incorporated by specific reference therein, constitute the complete and exclusive statement of the terms of the agreement operating the sale of Goods by HDE to Buyer, Buyer's acceptance of the Goods will make buyer's asceptance the set man and conditions without variation or addition. Any different or additional terms in Buyer's purchase order or other Buyer documents are hereby objected to. HDE reserves the right in its sole discretion to refuse orders.

1. PRICES AND TAXES: Unless a fixed price is quoted, the price at which this order is accepted is subject to adjustment to HDE's price in effect at the time of order. Any current or future tax or governmental charge (or increase in same) affecting Seleri's costs or production, sale or delivery or which Seleri is otherwise required to pay or collect in connection with the sale, purchase, delivery, storage, processing, use or consumption of Goods (but excluding any fave on Seleri's net income or profit) shall be for Buyer's account and shall be added to the price.

2. TERMS OF PAYMENT: Terms are stated on HDE's invoice in U.S. currency. HDE shall have the right, among other remedies, either to terminate this agreement or to suspend further performance under this and/or other agreements with the Buyer in the event Buyer falls to make any payment when due, which other agreements Buyer and Seleth hereby annead accordingly, or HDE otherwise deems liself insecure. Buyer shall be label for all expenses, including altomacys' less, relating to the collection of past due amounts. Should Buyer's financial responsibility become unsatisfactor by 10-EC, sach payments or security staffactory to HDE may by required by HDE for future deliveries and for the goods therefolder delivered. If such cash payment or security is not provided, in addition to HDE's other rights and remedies, HDE may discontinue deliveries. HDE may apply a finance charge for payments made by credit card.

3. SHPMENT AND DELVERY: Unless otherwise expressly provided, shipments are made F.O.B. HDE's shipping point, Risk of loss or dranage and responsibility shall pass from HDE to Buyer upon delivery to and receptly procured nor affect. Any claims for sharbages or dranages and selfered in transit are the responsibility of buyer and shall be submitted by the Buyer directly to the carriers. Sharbage or dranages must be acknowledged and signed for at the time of delivery, While HDE will use all responsible commercial efforts to maintain the delivery date(s) acknowledged or quoted by HDE, all shipping dates are approximate and not guaranteed. HDE reserves the right to make partial shipments. HDE, at the princip dates are approximate and not guaranteed. HDE reserves the right to make partial shipments. HDE is a thipping interest to the Cost is postponed or deligedy by Buyer for any reason, Buyer agrees to reimburse HDE for any and all handling and storage costs and other additional expenses resulting therefrom. All claims for shipping errors, tost shipments or any other discrepancies must be made within involve) (0) days or they will be disallowed and demend valved.

4. HDE LIMITED WARRANTY: HDE covers is products with a manufacturer's warranty against defects in material or workmanship or a period of ney years in the case of Capacitor Controls and in all other circumstances for a period of ney year unless otherwise stated by HDE in writing. To take advantage of this warranty, the complete prograpat to HDE or any HDE Authorized Service Center. This warranty shall not not apply to any Goods inclusing but not limited to products which: (a) Here been repaired or altered outside HDEs factory (or Authorized Service Center) or in any manner so as, in HDE's signment, a fifted its serviceability or proper operation, the programment of programment or proper operation, the programment or proper operation, and (a) Have been subjected to promain wear and tear, misses, negligence, improper installation or accident. HDE's obligation under this warranty, and the Buyer's exclusive remedy for the breach thereof, shall be limited to, at HDE's opinion, repair or replacement of any delegody defective Goods or insusance Goods are subjected to promote on or replacement of any class of the subject of the control of the subject of the subjec

5. LIMITATION OF REMEDY AND LIABILITY: THE SOLE AND EXCLUSIVE REMEDY FOR BREACH OF ANY WARRANTY HEREUNDER SHALL BE LIMITED TO REPAIR, CORRECTION, REPLACEMENT OF CREDIT UNDER SECTION 4. HID SHALL NOT BE LIABIL FOR DAMAGES CAUSED BY DELAY IN PERFORMANCE, AND IN NO EVENT, REGARDLESS OF THE FORM OF THE CHAIN OF THE CHAIN OF ACTION WHETHER BASED CONTINUES. THE FORM OF THE CHAIN OF THE CHAIN OF ACTION OF THE CHAIN OF THE CH

6. EXCUSE OF PERFORMANCE (FORCE MAJEURE): HDE shall not be liable for delays in performance or for non-performance due to acts of God; acts of Buyer, war, fire; flood; weather; sabotage; strikes, labor disputes, o'dl disturbances or rioks; governmental requests, restrictions, allocations, laws, regulations, orders or actions; unavailability of or delays in transportation; default of suppliers; or unforeseen circumstances or events beyond HDEs reasonable control. Deliverse or other performance may be suspended for a naproprisel period or cancelled by IVED groun fotio to line in the event of any of the foregonis, but the belance of this superement shall otherwise remain unaffected. IVED determines that its ability to supply the total demand for the Goods, or to obtain material used directly or indirectly in the manufacture of the Goods, is indirectly and the remainded to the Goods or materials and the remainded to the Goods or materials and the suppliers of any such Goods or materials) among itself and its purchasers on such basis as HDE determines to be equitable without liability for any failure of performance which may result therefrom.

7. CHANGES: HDE reserves the right to change designs and specifications for standard Goods without prior notice to Buyer, but not with respect to custom Goods being made for Buyer. HDE shall have no obligation to install or make such change in any Goods manufactured prior to the date of such change.

8. ASSIGNMENT: Buyer shall not assign its rights or delegate its duties hereunder or any interest herein without the prior written consent of HDE, and any such assignment, without such consent, shall be void

9. INSTALLATION: Buyer shall be responsible for receiving, inspecting, testing, storing, installing, starting up and maintaining all Goods

10. NSPECTIONTESTING: Buyer, at its expense, agrees that it will promptly inspect the Goods upon receipt thereof, and in no event later than thirty. (30) days from the date of receipt of the Goods. Buyer shall deliver to IDE within filters of 15 days of rempsection, but in no event later than forty-five, 60 days from the date of receipt of the Goods, written notice of any and all deficiencies, defects, variations from specifications or complaints of any kind with respect to the quantity, quality, condition, shipment, performance, price or appearance of the Goods so received by Buyer. In the event no such written notice is received by HDE. Buyer shall be deemed conclusively to have inspected and such Goods unconditionally any and all rights and claims, including withintion any right to reject the Goods or to diam damages in respect the reaction. Buyer may not return goods without first advising HDE of the reasons therefore, obtaining from HDE a material authorization number and observing such instructions as HDE may give in authorizing such return. In the event a return is authorizing for any Goods requiring reparkacing or maintenance a wenty percent (20%) restording fee shall be assessed to Buyer in the final credit amount.

11. SERVICEs: If this agreement requires HDE to perform or provide any services, HDE (including without limitation its successors, assigns, agents or any person or entity acting at HDE's direction) shall not be responsible for any damages, claims, liabilities or expenses of any nature arising out of such services.

12. U.S. EXPORT CONTROL LAWS: All Goods sold to Buver by HDE hereunder are subject to U.S. Export Control Laws. Buver hereby agrees not to re-sell or divert any goods contrary to such laws.

13. COMPLIANCE: Selenc'Ontractor shall comply with all applicable federal, state or local laws, rules, regulations, or orders. Selenc'Ontractor shall comply with Executive Order 11246, as amended by Executive Order 13758, and the applicable provisions for the Office of Federal Contract Compliance Programs (PCFCP), 41 CFR Part 60, which are incorporated wherein by the reference, Buyer shall comply with all applicable federal, state, or local laws, rules, regulations or orders including but not limited to the Foreign Corrupt Practices Act of 1977, as amended. HDE reserves the right to delay or refuse delivery if requests for reasonable assurances of Buyer's compliance are not Interfeder as requested.

14. MISCELLANEOUS: These terms and conditions superseds all other communications, negotiations and prior or all or written statements regarding the subject matter hereof. No change, modification, rescission, dischange, beandorment, or waiver of these terms and conditions shall be binding upon HDE unless made in writing and signed on its behalf by its duly authorized representative. No conditions, usage or trade, course of dealing or performance, undestanding or agreement purporting to modify, vary, explain, or supplement these terms and conditions shall be binding unless hereafter made in writing and signed by Seller. No modification shall be effected by HDEs receipt or acceptance of Buyer's purchase orders, shipping instruction forms, of other documentation containing terms at variance with or in addition to those self toth herein, all of which are objected to by HDEs. Any such modifications or additional terms are specification; presently rejected by HDEs whatever the deemed to constitute or offeatured any other breach or default of any other breach or default of any other breach or default of any other pith or remedy, unless such waiver be expressed in writing and signed by HDE. All typographical or defectal errors made by HDE in any source relating to the interpretation and effect of this agreement shall be governed by two of the state of limits on short of condition in such provides.

15. DISPUTE RESOLUTION: In the event of any dispute INCLUDING, BUT NOT LIMITED TO, BREACH OF CONTRACT, BREACH OF WARRANTY, CLAIMS BASED IN TORT, NEGLIGENCE, PRODUCT LIABILITY, FRAUD, MARKETING, STATE OR FEDERAL REGULATIONS, ANY CLAIMS REGARDING THE ENFORCEABILITY OF THIS LIMITED WARRANTY, AND THE WAIVER OF CLASS ACTION TRIALS between Buyer and Seller, either may choose to resolve the dispute by binding arbitration, as described below, instead of in out. THIS MEANS IF EITHERY OR SELLER CHOOSE BINDING ARBITRATION, DIFFIER PARTY SHALL HAVE THE RIGHT TO LITIGATE SUCH CLAIM IN COURT OR HAVE A JURY TRIAL. DISCOVERY AND APPEAL RIGHTS ARE LIMITED IN BINDING ARBITRATION. Buyer and Seller agree that the proper usure if Arbitration in on sto schosen by Buyer or Seller of all actions arising in connection herewith shall be only in the state of liminos and the agree to submit to sch jurisdiction. No acid, negardess of form, arising out of transactions relating to the agreement, may be brought by either party more than two (2) years after the cause of action has accrued. The U.N. Convention on Contracts for the International Sales of Goods shall not anyly in this accruence.

16. CLASS ACTION WAIVER: BINDING ARBITRATION MUST BE ON AN INDIVIDUAL BASIS. THIS MEANS NEITHER BUYER NOR SELLER MAY JOIN OR CONSOLIDATE CLAIMS IN ARBITRATION BY OR AGAINST OTHERS, OR LITIGATE IN COURT OR ARBITRATE ANY CLAIMS AS A REPRESENTATIVE OR MEMBER OF A CLASS OR IN A PRIVATE ATTORNEY GENERAL CAPACITY. ADMINISTRATION OF ARBITRATION OF ARBITRATION. THE ARBITRATION HAVE A CONTROL OF A COURT OF A COUR

HD Electric Company is committed to ongoing review and improvement of its product lines, and thus reserves the right to modify product design and specifications without notice.

HD Electric Company® products are available through HDE® sales representatives worldwide.

HD Electric products receive final assembly and shipment from HDE's production facility at

Suite 400 - 4320 Executive Drive, Southaven, MS 38672.

HD Electric Company is ISO 9001:2015 certified